


### Flow Characteristic Curve – R225SR4



Weir flow - 1 L/s (10mm)

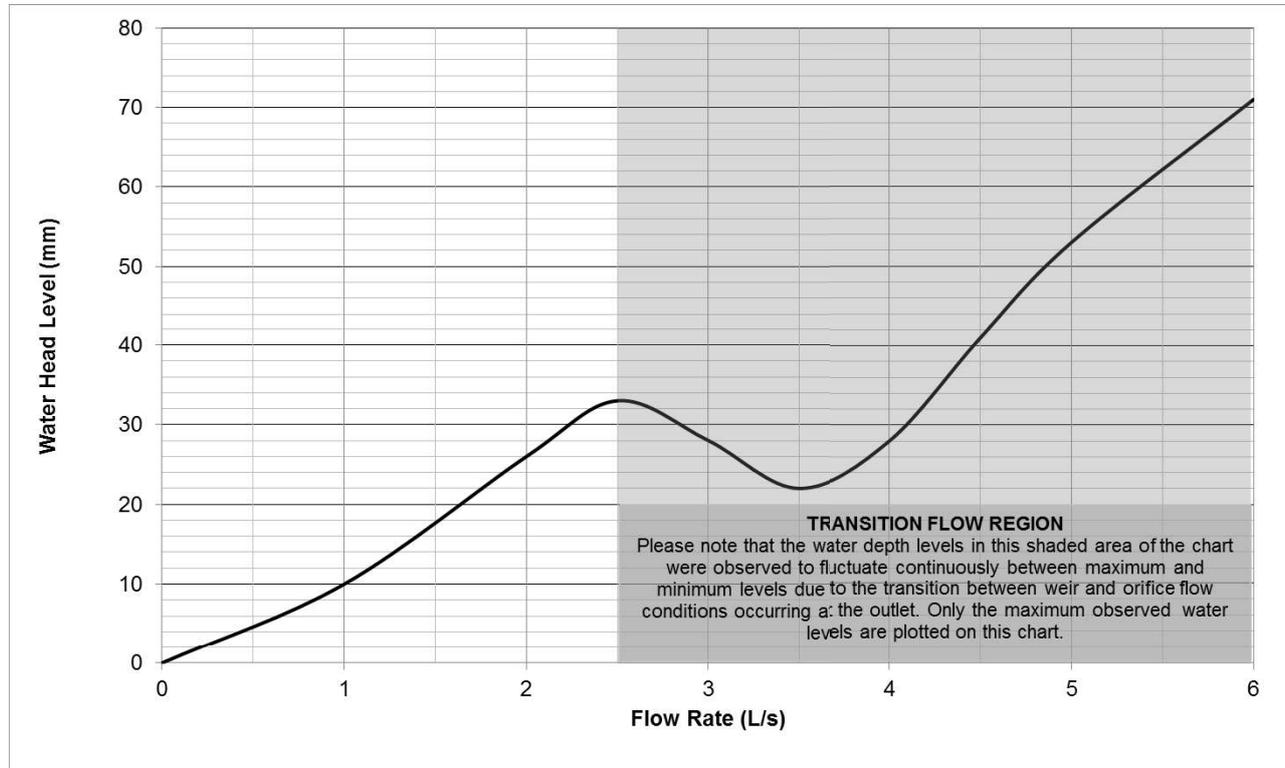

Surcharged flow – 3 L/s (30mm)

#### Observation Comments:

- Flow rates from 0-2.5 L/s (35mm Head) produced a linear characteristic curve.
- At 3.0 L/s the weir flow transitioned to vortex flow, then surcharged. From 3.5 - 6 L/s the flow conditions cycled between vortex and surcharged flow characterised by the water level fluctuating 10 -20mm.
- The maximum flow limit to maintain weir flow conditions is 2.5 L/s.


I hereby certify that the test results presented on this outlet performance certificate are true and correct and were obtained using recognised AHSCA Gutter Outlet Testing procedures.

Dr Terry Lucke,  
Chief Researcher:



Date: 16<sup>th</sup> November 2016

Mark Alexander,  
AHSCA Foundation Chairman:



Date: 16<sup>th</sup> November 2016